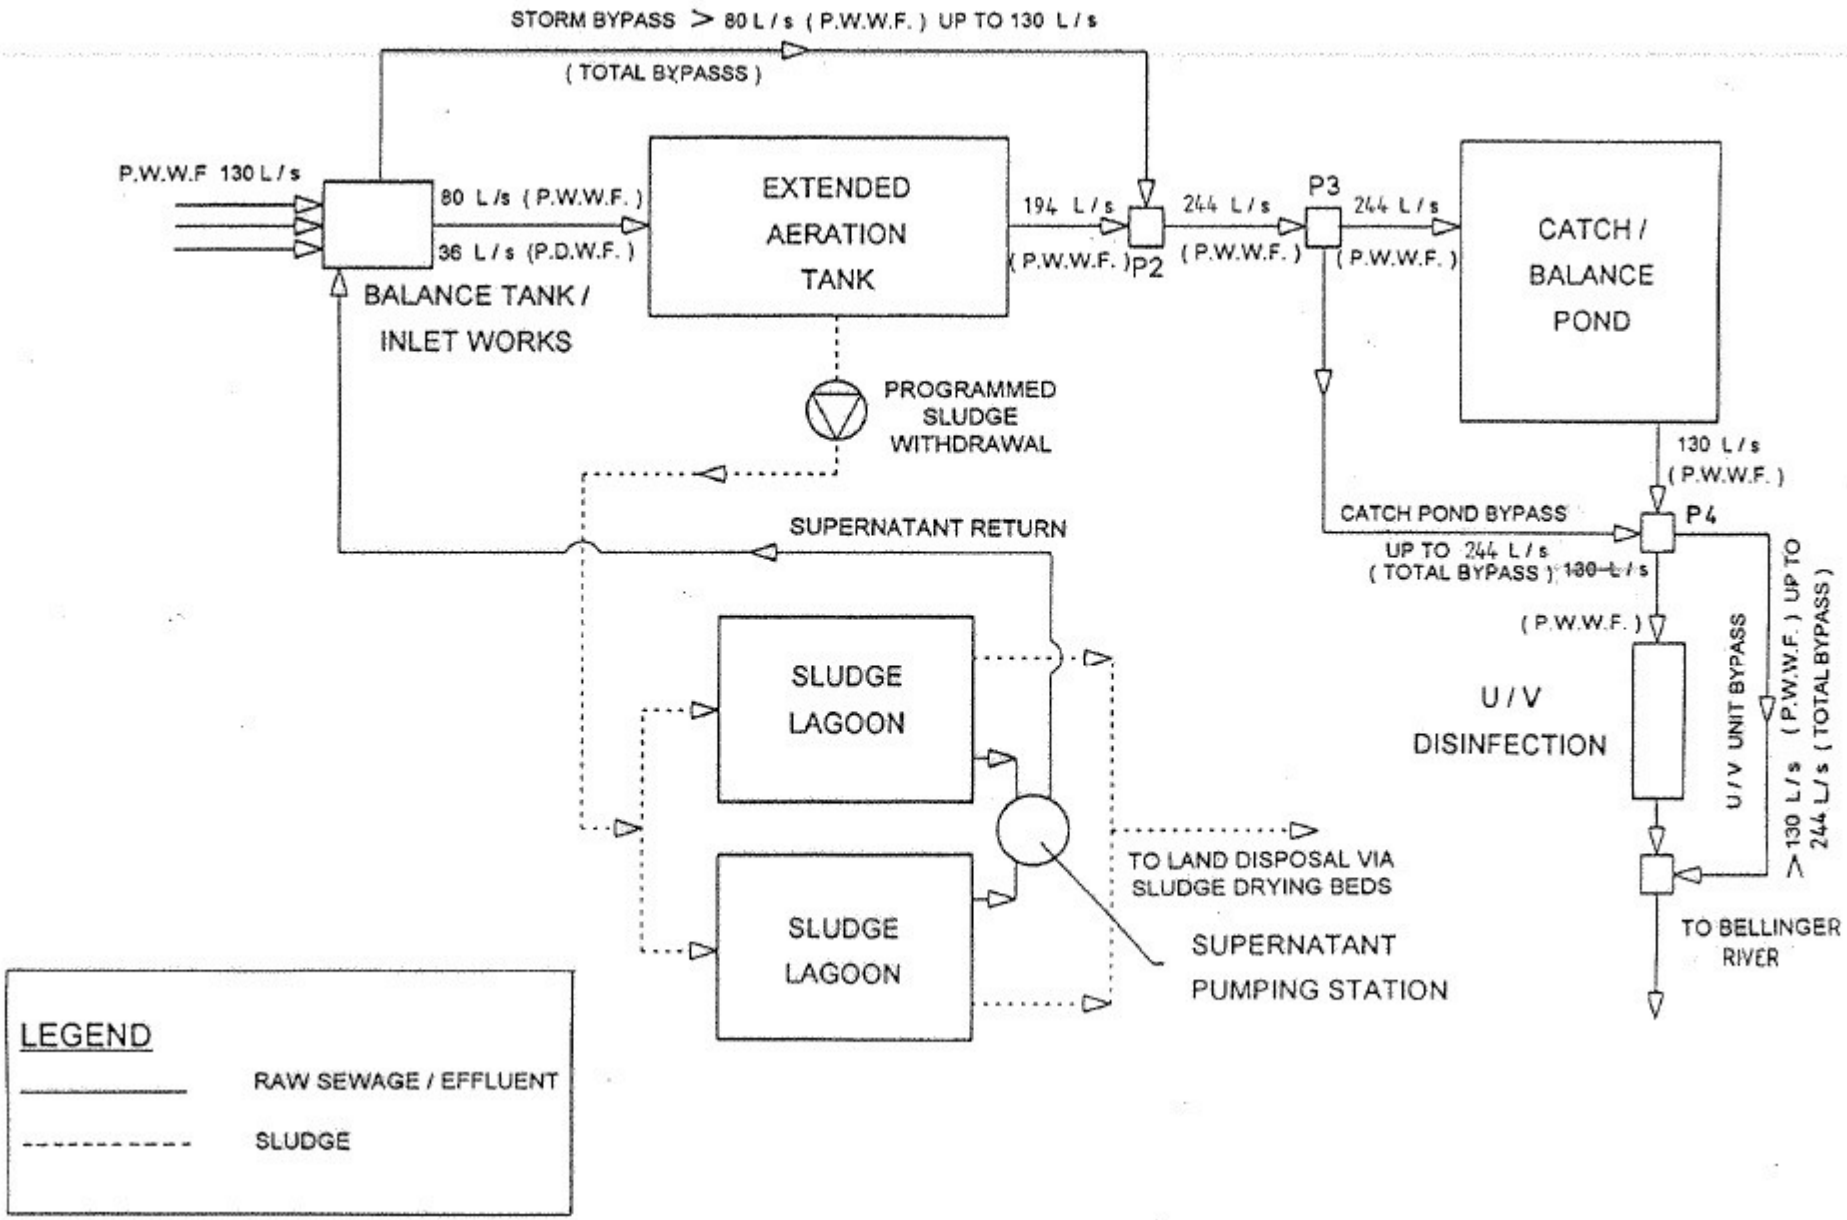
STORM BYPASS > 80 L / s (P.W.W.F.) UP TO 130 L / s
(TOTAL BYPASSS)
P.W.W.F 130 L / s
80 L /s (P.W.W.F.)
36 L / s (P.D.W.F.)
BALANCE TANK / INLET WORKS
EXTENDED AERATION TANK
194 L / s
(P.W.W.F.)
P2
244 L / s
(P.W.W.F.)
P3
244 L / s
(P.W.W.F.)
CATCH / BALANCE POND
PROGRAMMED SLUDGE WITHDRAWAL
130 L / s
(P.W.W.F.)
CATCH POND BYPASS
P4
UP TO 244 L / s
(TOTAL BYPASS) 130 L / s
SUPERNATANT RETURN
(P.W.W.F.)
U / V DISINFECTION
U / V UNIT BYPASS
130 L / s (P.W.W.F.) UP TO 244 L / s (TOTAL BYPASS)
SLUDGE LAGOON
SLUDGE LAGOON
TO LAND DISPOSAL VIA SLUDGE DRYING BEDS
SUPERNATANT PUMPING STATION
TO BELLINGER RIVER
LEGEND
RAW SEWAGE / EFFLUENT
SLUDGE